

**Key:**

StrataBit Capsheet



StrataBase Underlay

**Construction Notes:**

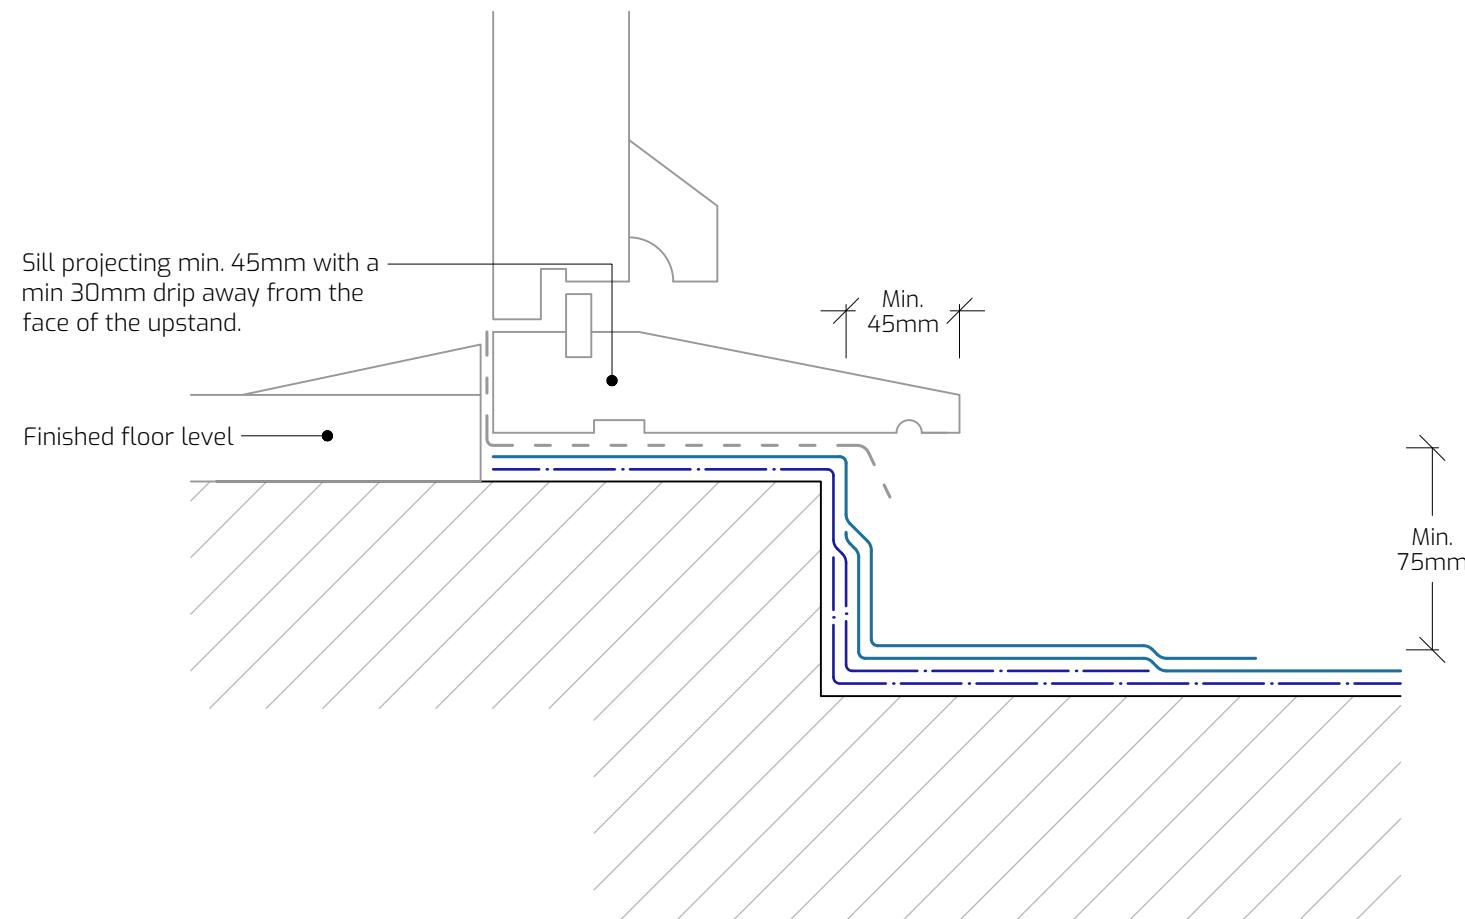
A strip of StrataBit Capsheet and StrataBase Underlay, should be brought over the detail below the sill as indicated.

The sill should project min. 45mm over the terrace area with a drip min. 30mm away from the face of the upstand to shed water away from the interface with the waterproofing layer.

The system build-up and application should adhere to the STRATA issued specification.

All surfaces must be clean, dry, and suitably prepared to accept the waterproofing system.

All details should be installed in full compliance with the most up-to-date NHBC Standards, BS 8217, BS 6229, and STRATA recommendations.

**Drawing Title:** Accessible Threshold**Drawing Number:** SB-T0-C19**Scale:** 1:3**Drawn By:** E.V.**Date:** 26/09/2025T: 028 9030 2924 | E: [technical@stratawaterproofing.com](mailto:technical@stratawaterproofing.com) | W: [www.stratawaterproofing.com](http://www.stratawaterproofing.com)

Copyright Reserved - Please note that this drawing and the copyright therein is the property of Strata Waterproofing Systems and is issued on the understanding that the drawing or any detail thereof shall not be divulged to a third party unless written permission is first obtained from Strata Waterproofing Systems. The drawing is valid only when approved by the Architect/Contractor concerned.

This detail is representative of a typical situation and provided for illustration purposes. Insulation thickness shown may differ in accordance with the specified U-value requirement.

